

Large Family Daycare Fire Alarm Systems

Kern County Fire Department



Office of the Fire Marshal ~ Fire Prevention
2820 M St. ~ Bakersfield, CA 93301
Telephone (661) 391-3310 ~ Fax (661) 636-0466/67


Website: kerncountyfire.org

Email: fireprevention@kerncountyfire.org



Large family daycare businesses, 9 to 14 children, shall have a manual fire alarm that alerts the occupants of fire. These alarms are simply a manual pull station and a bell or other audio device used in a commercial fire alarm. These devices are available from many local fire alarm companies or on-line from different suppliers.

The diagram below shows a 115 Volt A/C fire alarm bell and a manual pull station capable of supporting the amperage of the bell. This system would be hardwired into the homes electrical system. This system is not monitored.

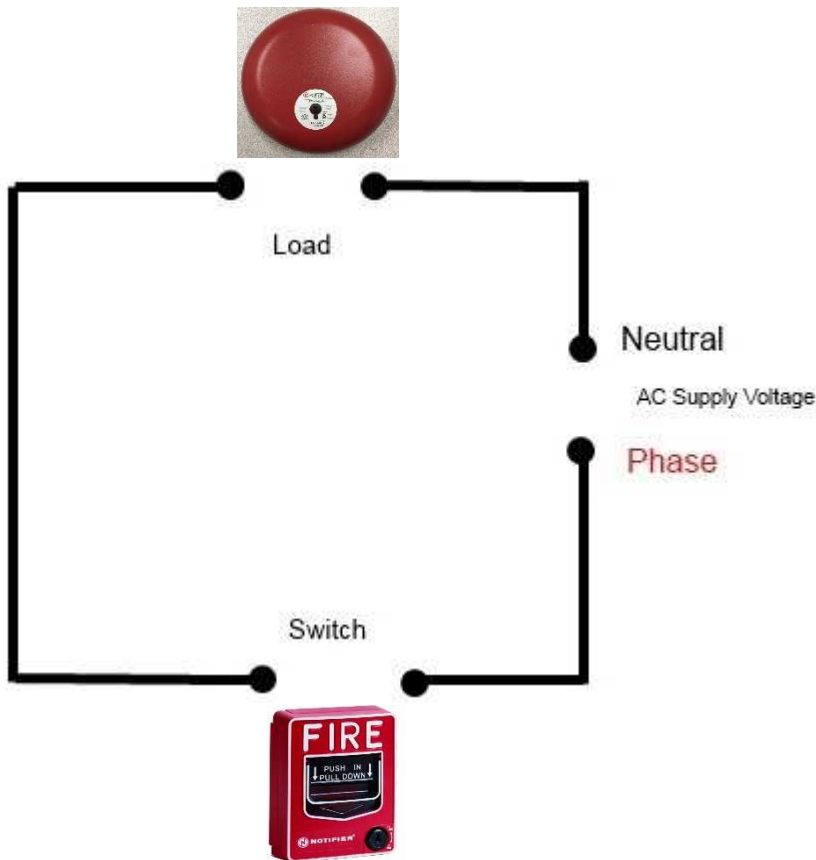

This is just one way to build this system and this document shall only be used as an example of one way to assemble it. **Please consult a licensed electrical contractor for all electrical wiring.**